


## ATLAS200 MODEL UPS DAĞITIM PANOSU

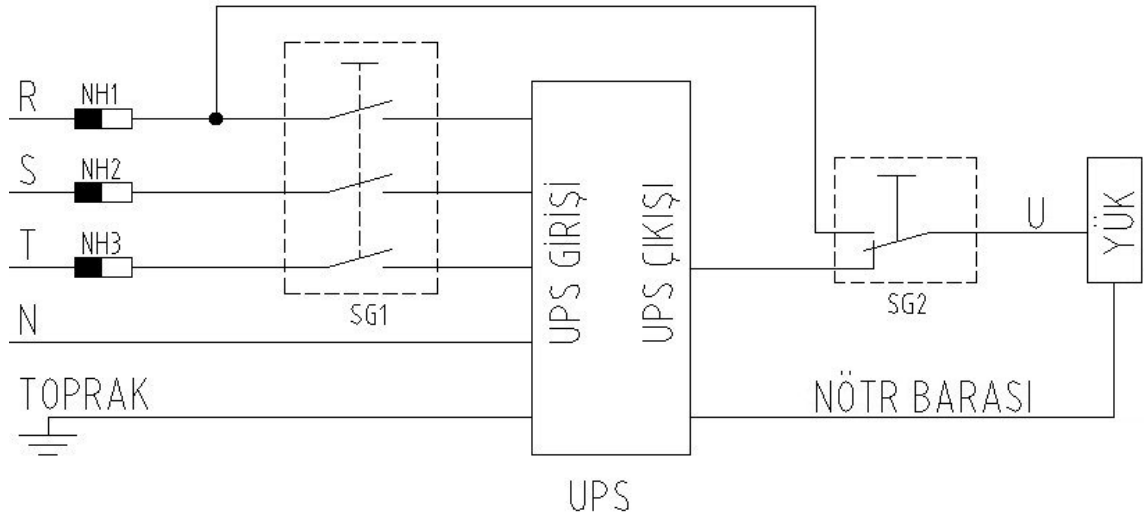

UPS GÜCÜ (kVA)	GİRİŞ KABLO KESİTİ	ÇIKIŞ KABLO KESİTİ	TOPRAK KABLO KESİTİ	NH1 NH2 NH3	SG1 (0-1) KONUMLU PAKO ŞALTER	SG2 (1-0-2) KONUMLU PAKO(ENVERSÖR) ŞALTER
7,5	3x4+4 mm <sup>2</sup>	2x6 mm <sup>2</sup>	1x4 mm <sup>2</sup>	32A	3x32A	1x40A
10	3x4+4 mm <sup>2</sup>	2x6 mm <sup>2</sup>	1x4 mm <sup>2</sup>	40A	3x40A	1x50A
15	3x6+6 mm <sup>2</sup>	2x10 mm <sup>2</sup>	1x6 mm <sup>2</sup>	40A	3x50A	1x63A
20	3x10+10 mm <sup>2</sup>	2x10 mm <sup>2</sup>	1x6 mm <sup>2</sup>	63A	3x63A	1x100A
30	3x16+16 mm <sup>2</sup>	2x16 mm <sup>2</sup>	1x16 mm <sup>2</sup>	80A	3x80A	1x160A